

Analog Input Modules

| F4-16AD-1 \$1,054.00 16-Channel Analog Current Input | |
|-----------------------------------------------------------------------|-----------------------------------------------------------------------------------|
| Number of Channels | 16, single ended (one common) |
| Input Ranges | 0–20 mA, 4–20 mA |
| Channels Individually Configurable | No. Each channel can be configured for current or voltage but must be same range. |
| Resolution | 12 bit (1 to 4,096) |
| Active Low-pass Filtering | -3dB at 20Hz, -12 dB per octave |
| Input Impedance | 250Ω ± 0.1%, 1/2W current input >20MΩ voltage input 1 MΩ minimum |
| Absolute Maximum Ratings | -45mA to + 45mA, current input -75V to +75V, voltage input |
| Conversion Time | 2ms per channel (module conversion) |
| Linearity Error (End to End) | ± 2 count (0.025% of full scale) max. |
| Input Stability | ± 1 count |
| Full Scale Calibration Error (Offset error not included) | ± 12 counts max. @ 20mA current input |
| Offset Calibration Error | ± 3 counts max., 4mA current input |

See Wiring Solutions for part numbers of ZIPLink cables and connection modules compatible with this I/O module.



| | |
|--------------------------------------|------------------------------------------------------------------------------|
| PLC Update Rate | 1 channel per scan min., 16 per scan, max. |
| Digital Input Points Required | 16 (X) input points (12 binary data bits, 4 active channel bits) |
| Base Power Required 5V | 100mA |
| Terminal Type (included) | Removable |
| External Power Supply | 21.6-26.4VDC, 100mA, class2 |
| Recommended Fuse | 0.032 A, Series 217 fast-acting, current inputs |
| Operating Temperature | 32° to 140°F (0 to 60°C) |
| Accuracy vs. Temperature | ± 50ppm /°C maximum full scale (including maximum offset change of 2 counts) |
| Storage Temperature | -4 to 158°F (-20 to 70° C) |
| Relative Humidity | 5 to 95% (non-condensing) |
| Environmental Air | No corrosive gases permitted |
| Vibration | MIL STD 810C 514.2 |
| Shock | MIL STD 810C 516.2 |
| Noise Immunity | NEMA ICS3-304 |

One count in the specification table is equal to one least significant bit of the analog data value (1 in 4096).


NOTE 1: Shields should be grounded at the signal source.

A Series 217, 0.032A, fast-acting fuse is recommended for 4-20 mA current loops.

If the power supply common of an external power supply is not connected to 0VDC on the module, then the output of the external transmitter must be isolated.

To avoid "ground loop" errors, recommended 4-20 mA transmitter types are:
2 or 3 wire: Isolation between input signal and power supply.

4 wire: Isolation between input signal, power supply and 4-20 mA output.

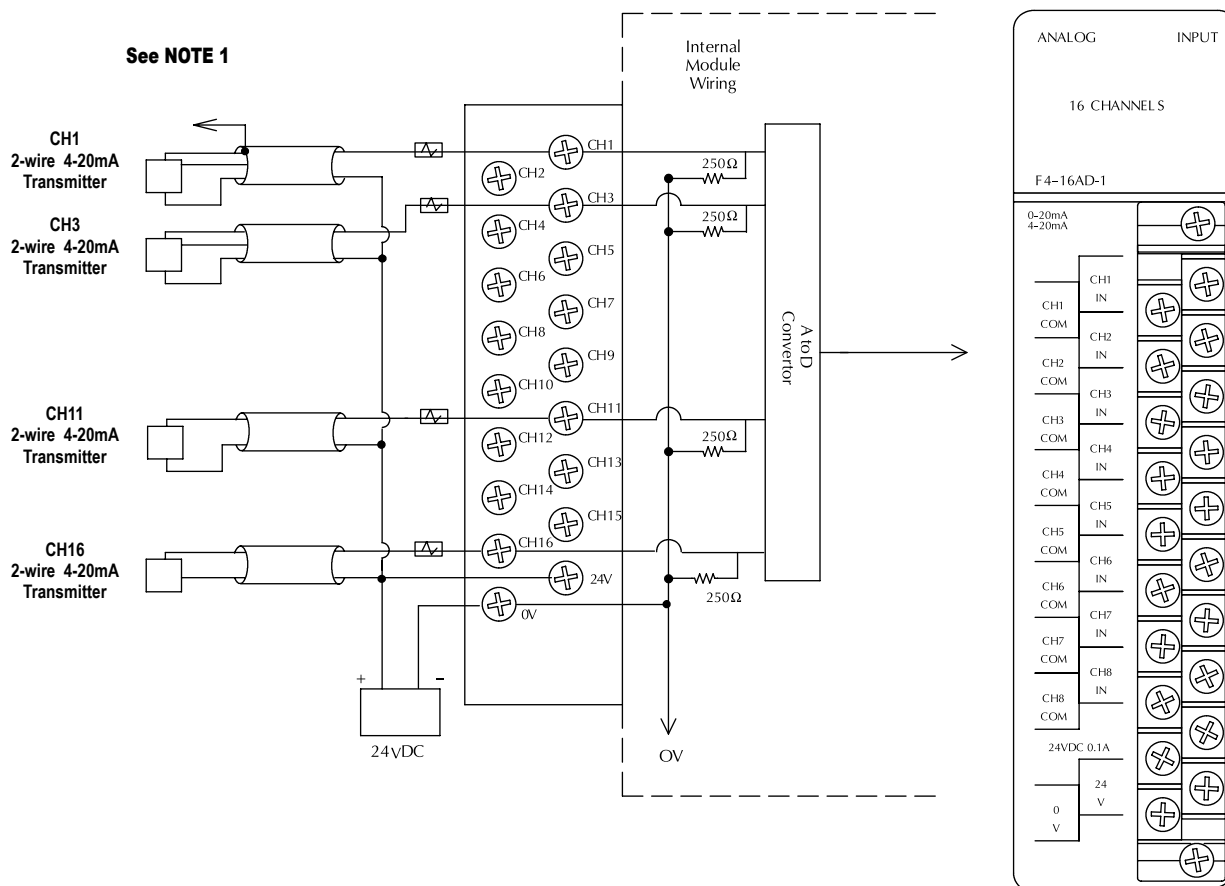

Check the Power Budget

Verify your power budget requirements

Your I/O configuration choice can be affected by the power requirements of the I/O modules you choose. When determining the types and quantity of I/O modules you will be using, it is important to remember there is a limited amount of power available from the power supply.

The chart on the opposite page indicates the power supplied and used by each DL405 device. The adjacent chart shows an example of how to calculate the power used by your particular system. These two charts should make it easy for you to determine if the devices you have chosen fit within the power budget of your system configuration.

If the I/O you have chosen exceeds the maximum power available from the power supply, you can resolve the problem by shifting some of the modules to an expansion base or remote I/O base (if you are using remote I/O).

Warning: It is extremely important to calculate the power budget correctly. If you exceed the power budget, the system may operate in an unpredictable manner which may result in a risk of personal injury or equipment damage.

Use ZIPLinks to reduce power requirements

If your application requires a lot of relay outputs, consider using the Ziplink AC or DC relay output modules. These modules can switch high current (10A) loads without putting a load on your base power budget. Refer to Wiring System for DL405 PLCs later in this section for more information.

This logo is placed next to I/O modules that are supported by the Ziplink connection systems.



See the I/O module specifications at the end of this section.

Calculating your power usage

The following example shows how to calculate the power budget for the DL405 system. The example is constructed around a single 8-slot base using the devices shown. It is recommended you construct a similar table for each base in your system.

| | | | | |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|-------------|----------------|----------------------------|
| A | | | | |
| | Base Number 0 | Device Type | 5 VDC (mA) | External 24 VDC Power (mA) |
| B | CURRENT SUPPLIED | | | |
| | CPU/Expansion Unit /Remote Server | D4-454 CPU | 3700 | 400 |
| C | CURRENT REQUIRED | | | |
| | SLOT 0 | D4-16ND2 | +150 | +0 |
| | SLOT 1 | D4-16ND2 | +150 | +0 |
| | SLOT 2 | F4-04DA-2 | +90 | +90 |
| | SLOT 3 | D4-08NA | +100 | +0 |
| | SLOT 4 | D4-08NA | +100 | +0 |
| | SLOT 5 | D4-16TD2 | +100 | +0 |
| | SLOT 6 | D4-16TD2 | +100 | +0 |
| | SLOT 7 | D4-16TR | +1000 | +0 |
| D | OTHER | | | |
| | BASE | D4-08B-1 | +80 | +0 |
| | Handheld Programmer | D4-HPP-1 | +320 | +0 |
| E | Maximum Current Required | | 2190 | 90 |
| F | Remaining Current Available | | 3700-2190=1510 | 400-90=310 |
| 1. Using a chart similar to the one above, fill in column 2. 2. Using the tables on the opposite page, enter the current supplied and used by each device (columns 3 and 4). Pay special attention to the current supplied by the CPU, Expansion Unit, and Remote Server since they differ. Devices which fall into the "Other" category (Row D) are devices such as the Base and the Handheld programmer, which also have power requirements, but do not plug directly into the base. 3. Add the current used by the system devices (columns 3 and 4) starting with Slot 0 and put the total in the row labeled "maximum current required" (Row E). 4. Subtract the row labeled "Maximum current required" (Row E), from the row labeled "Current Supplied" (Row B). Place the difference in the row labeled "Remaining Current Available" (Row F). 5. If "Maximum Current Required" is greater than "Current Supplied" in either column 3 or 4, the power budget will be exceeded. It will be unsafe to use this configuration and you will need to restructure your I/O configuration. Note the auxiliary 24VDC power supply does not need to supply all the external power. If you need more than the 400mA supplied, you can add an external 24VDC power supply. This will help keep you within your power budget for external power. | | | | |

DL405 CPU power supply specifications and power requirements

| Specification | AC Powered Units | 24 VDC Powered Units |
|---------------------------------------|------------------------------------------------------------------------------|------------------------------------------------|
| Part Numbers | D4-454, D4-EX (expansion base unit), D4-RS (remote Server unit) | D4-454DC-1, D4-EXDC (expansion base unit) |
| Voltage Withstand (dielectric) | 1 minute @ 1,500 VAC between primary, secondary, field ground, and run relay | |
| Insulation Resistance | > 10MΩ at 500VDC | |
| Input Voltage Range | 85-132 VAC (110V range) 170-264 VAC (220V range) | 20-28 VDC (24VDC) with less than 10% ripple |
| Maximum Inrush Current | 20A | 20A |
| Maximum Power | 50VA | 38W |

Power Requirements

| Power Supplied | | | | | |
|---------------------------------------|---------------------------------|---------------------------------|---------------------------------------|------------------------------|------------------------------------|
| CPUs/Remote Units/ Expansion Units | 5 VDC Current Supplied in mA | 24V Aux Power Supplied in mA | CPUs/Remote Units/ Expansion Units | 5V Current Supplied in mA | 24V Aux Power Supplied in mA |
| D4-454 CPU D4-454DC-1 | 3100 3100 | 400 NONE | D4-EX D4-EXDC D4-RS H4-EBC | 4000 4000 3700 3470 | 400 NONE 400 400 |
| Power Consumed | | | | | |
| Power-consuming Device | 5V Current Consumed | External 24VDC Required | Power-consuming Device | 5V Current Consumed | External 24VDC Current Required |
| I/O Bases | | | Analog Modules (continued) | | |
| D4-04B-1 | 80 | NONE | F4-16AD-1 | 75 | 100 |
| D4-06B-1 | 80 | NONE | F4-16AD-2 | 75 | 100 |
| D4-08B-1 | 80 | NONE | F4-08DA-1 | 70 | 75+20 per circuit |
| | | | F4-08DA-2 | 90 | 90 |
| | | | F4-04DAS-1 | 60 | 60 per circuit |
| | | | F4-08DA-1 | 90 | 100+20 per circuit |
| | | | F4-08DA-2 | 80 | 150 |
| | | | F4-16DA-1 | 90 | 100+20 per circuit |
| | | | F4-16DA-2 | 80 | 25 max. |
| | | | F4-08RTD | 80 | NONE |
| | | | F4-08THM-J(-n) | 120 | 50 |
| | | | F4-08THMF4-08THM | 110 | 60 |
| DC Input Modules | | | Remote I/O | | |
| D4-16ND2 | 150 | NONE | H4-ERM100 | 320(300) | NONE |
| D4-16ND2F | 150 | NONE | H4-ERM-F | 450 | NONE |
| D4-32ND3-1 | 150 | NONE | D4-RM | 300 | NONE |
| D4-64ND2 | 300 max. | NONE | | | |
| AC Input Modules | | | Communications and Networking | | |
| D4-08NA | 100 | NONE | H4-ECOM100 | 300 | NONE |
| D4-16NA | 150 | NONE | D4-DCM | 500 | NONE |
| | | | F4-MAS-MB | 235 | NONE |
| AC/DC Input Modules | | | CoProcessors | | |
| D4-16NE3 | 150 | NONE | F4-CP128-1 | 305 | NONE |
| DC Output Modules | | | Specialty Modules | | |
| D4-16TD1 | 200 | 125 | H4-CTRIO | 400 | NONE |
| D4-16TD2 | 400 | NONE | D4-16SIM | 150 | NONE |
| D4-32TD1 | 250 | 140 | F4-4LTC | 280 | 75 |
| D4-32TD2 | 350 | 120 (4A max including loads) | | | |
| D4-64TD1 | 800 | NONE | | | |
| AC Output Modules | | | Programming | | |
| D4-08TA | 250 | NONE | D4-HPP-1 (Handheld Prog.) | 320 | NONE |
| D4-16TA | 450 | NONE | Operator Interface | | |
| Relay Output Modules | | | C-more Micro-Graphic | 210 | NONE |
| D4-08TR | 550 | NONE | | | |
| F4-08TRS-1 | 575 | NONE | | | |
| F4-08TRS-2 | 575 | NONE | | | |
| D4-16TR | 1000 | NONE | | | |
| Analog Modules | | | | | |
| F4-04AD | 150 | 100 | | | |
| F4-04ADS | 370 | 120 | | | |
| F4-08AD | 75 | 90 | | | |